



**NOTES:**


1. COMPACTION AND TESTING FOR ALL AGGREGATE BASE/SUBBASE MATERIAL SHALL BE IN ACCORDANCE WITH ISWPC SECTION 802.
2. COMPACTION AND TESTING FOR ALL HOT MIX ASPHALT MATERIAL SHALL BE IN ACCORDANCE WITH ISWPC SECTION 810.
3. ALL POTHOLE REPAIRS LOCATED WITHIN A CITY OF McCALL RIGHT-OF-WAY TO COMPLY WITH THE CITY OF McCALL STANDARD REVISIONS TO THE 2020 ISWPC AND SUPPLEMENTAL CONDITIONS SECTION 303.
4. SAWCUT EXISTING PAVEMENT A MINIMUM OF TWELVE (12") INCHES FROM THE EDGE OF THE POTHOLE. SAWCUT SECTION TO BE SQUARE AND SAWCUT LINE TO BE LOCATED OUTSIDE OF THE WHEEL PATH WHEN AT ALL POSSIBLE. SAWCUT AND TACK ALL COLD JOINT SURFACES WITH EMULSION PRIOR TO PATCHING.
5. ALL MATERIAL TO BE COMPACTED TO AT LEAST 95% OPTIMUM DENSITY PER AASHTO T99. REFER TO ISWPC SECTION 306 AND CITY OF McCALL STANDARDS FOR ADDITIONAL INFORMATION.
6. ALL WORKMANSHIP LOCATED WITHIN A CITY OF McCALL RIGHT-OF-WAY TO CARRY A 2-YEAR WARRANTY.
7. COMPLETED PATCH WORK SHALL NOT POND/POOL WATER.
8. COMPLETED PATCH SHALL NOT DEVIATE FROM EXISTING SURFACE MORE THAN 0.03FT/10 FT IN STRAIGHT PROFILE OR 0.05FT/10 FT IN CROSS SECTION WHEN MEASURED WITH A 10 FT STRAIGHT EDGE.
9. WHERE 50% OR MORE OF THE SURFACE AREA OF THE PAVEMENT IN THE TRAVEL LANE HAS BEEN REMOVED OR DAMAGED, FULL WIDTH RESTORATION SHALL BE REQUIRED.
10. FOR SURFACE REPAIR WITHIN ASPHALT SURFACES, A MINIMUM OF TWELVE (12") INCHES OF TYPE III BEDDING MATERIAL PER ISWPC SECTION 305 IS REQUIRED ABOVE EXPOSED UTILITY. CONTROLLED DENSITY FILL TO BE INSTALLED ABOVE TYPE III BEDDING AND BOTTOM OF EXISTING ASPHALT SURFACE. ASPHALT USED SHALL BE HMA, MATCH EXISTING TYPE, SPECIFICATIONS, AND DEPTH OF EXISTING ASPHALT, OR MINIMUM OF THREE (3") INCHES, WHICHEVER IS GREATER.
11. FOR SURFACE REPAIR WITHIN GRAVEL SURFACES, TYPE III BEDDING MATERIAL PER ISWPC SECTION 305 IS REQUIRED ABOVE EXPOSED UTILITY TO WITHIN TWELVE (12") INCHES OF FINISHED GRADE. TWELVE (12") INCHES OF TYPE I AGGREGATE PER ISWPC SECTION 802 TO BE USED TO FINISHED GRADE.
12. FOR SURFACE REPAIR LOCATED WITHIN VEGETATED SWALES AND NON-GRAVEL OR ASPHALT SURFACES, TYPE III BEDDING MATERIAL PER ISWPC SECTION 305 IS REQUIRED ABOVE EXPOSED UTILITY TO WITHIN 4" OF FINISHED GRADE. PLACE FOUR (4") INCHES OF TOPSOIL AT FINISHED GRADE AND RE-VEGETATE WITH NATIVE DROUGHT TOLERANT GRASS SEED MIXTURE.
13. ASPHALT CUTS AND PATCHES WILL NOT BE ALLOW WITHIN THE WHEEL PATHS AND ALL CORNERS SHALL BE STRAIGHT CUTS (NOT RADIUS) UNLESS PRIOR WRITTEN APPROVAL FROM THE CITY OF McCALL PUBLIC WORKS DEPARTMENT HAS BEEN GRANTED.

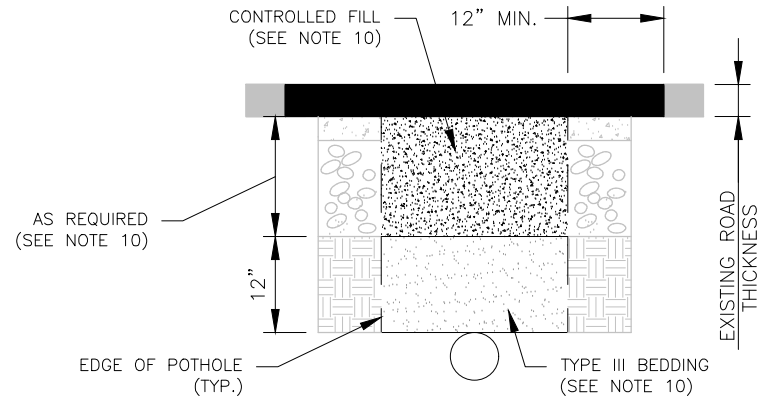


**ASPHALT SURFACE REPAIR**

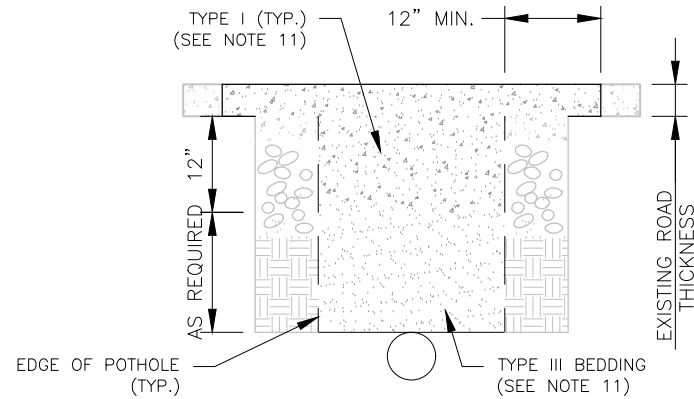

**GRAVEL SURFACE REPAIR**

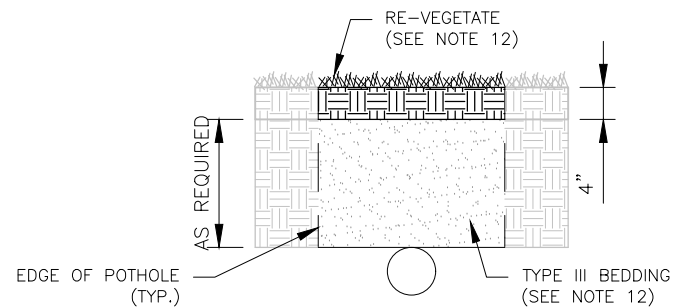

**VEGETATIVE SURFACE REPAIR**

 <b>City of McCall</b> PUBLIC WORKS	<b>PUBLIC WORKS DEPARTMENT</b> 815 N. SAMSON TRAIL McCALL, IDAHO 83638 208.634.5580	<b>CITY OF McCALL</b> <b>TYPICAL POTHOLE SURFACE REPAIR</b>			STANDARD DRAWING NO.  <b>MSD-306</b>
		PROJECT .	DRAWN BY .	SHEET NO.	
		DATE 1/12/2023	1 OF 1		